


CP9000 Hookup Diagram

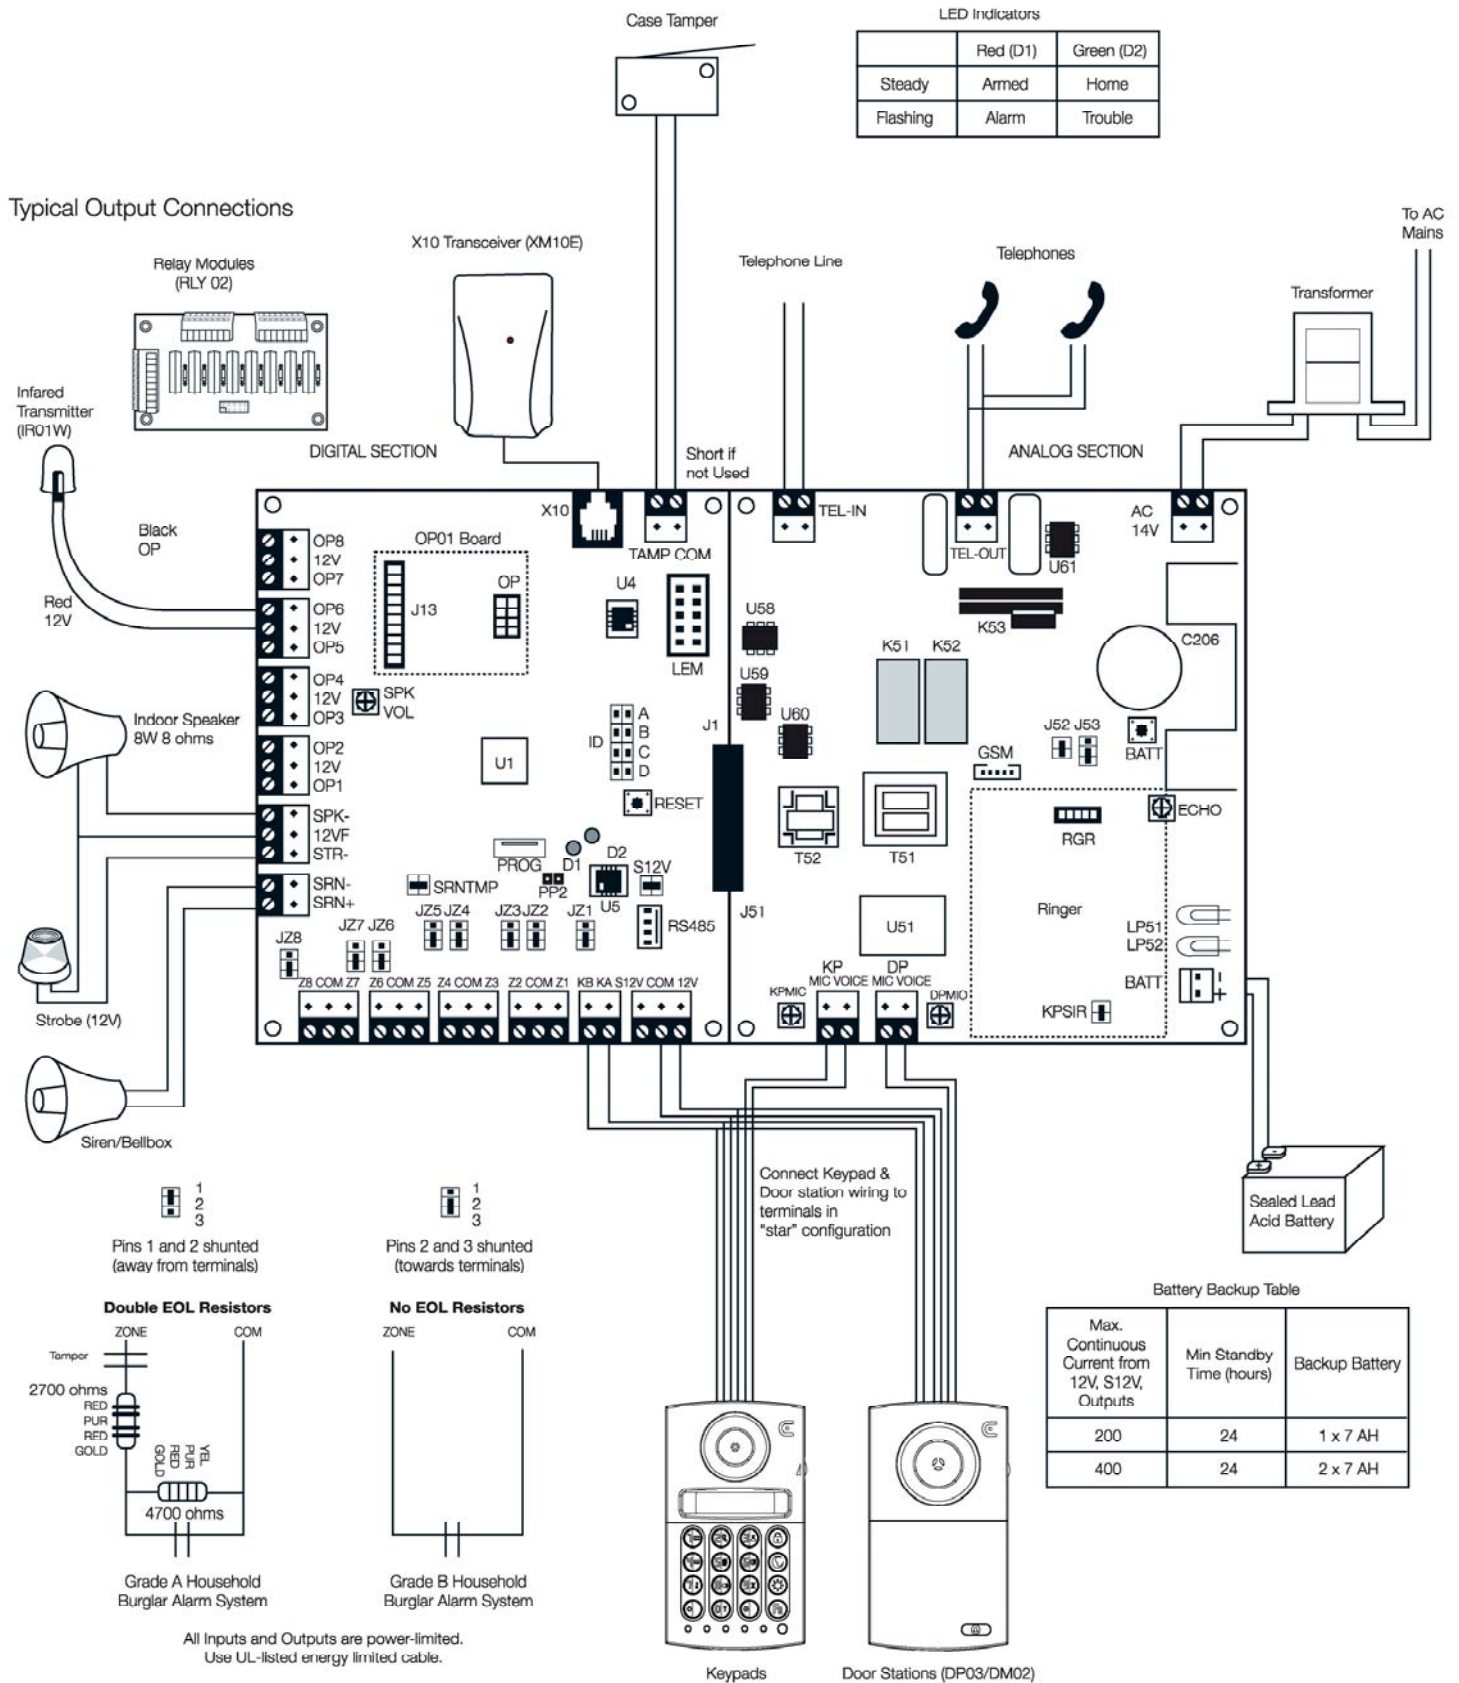

Mains electrical connection should be performed by qualified electricians, and must comply with local safety and electrical regulations. Supply should be from an unswitched fused mains socket.